


# OVERHEAD SERVICE MAST SPECIFICATION

HART EMC  
P. O. BOX 250  
HARTWELL, GA. 30643

1-800-241-4109  
376-4714

2/10/2003

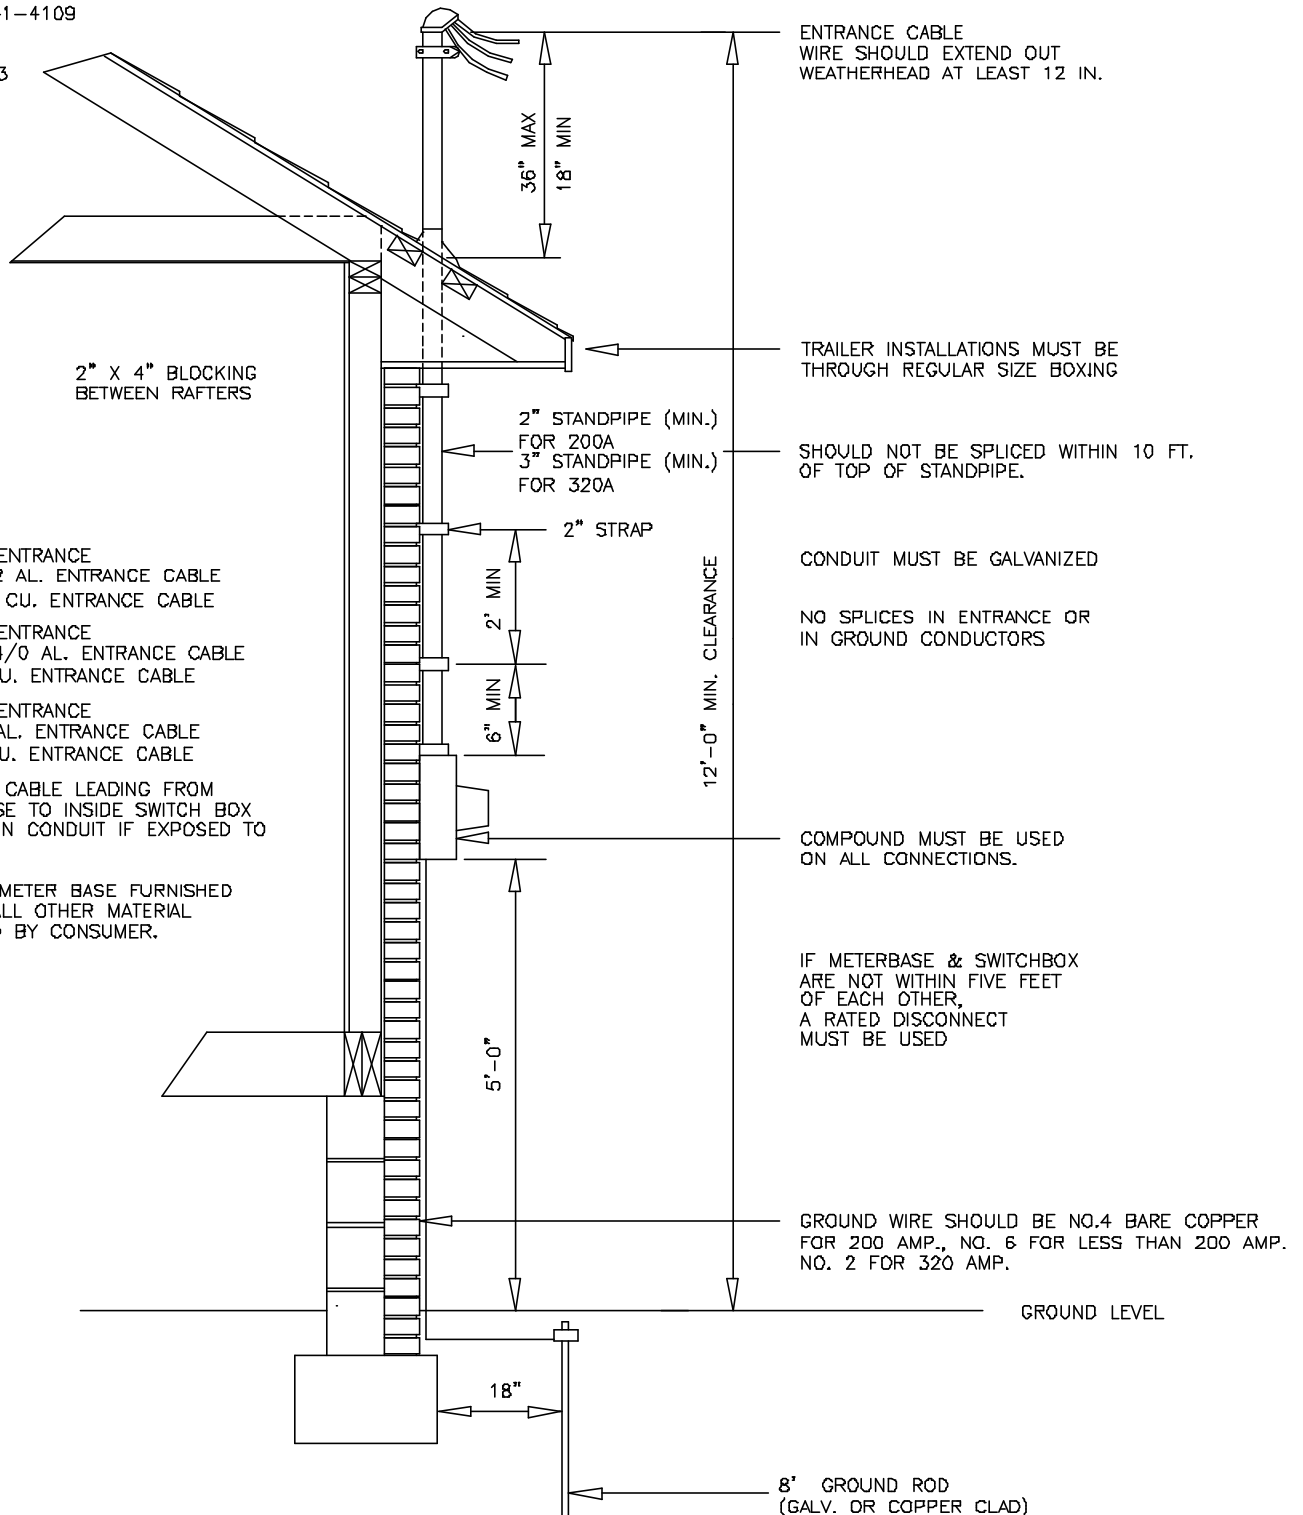

**NOTE:**

100 AMP ENTRANCE  
USE NO. 2 AL. ENTRANCE CABLE  
OR NO. 4 CU. ENTRANCE CABLE

200 AMP ENTRANCE  
USE NO. 4/0 AL. ENTRANCE CABLE  
OR 2/0 CU. ENTRANCE CABLE

320 AMP ENTRANCE  
USE 350 AL. ENTRANCE CABLE  
OR 250 CU. ENTRANCE CABLE

ENTRANCE CABLE LEADING FROM  
METER BASE TO INSIDE SWITCH BOX  
MUST BE IN CONDUIT IF EXPOSED TO  
OUTSIDE.

METER & METER BASE FURNISHED  
BY EMC. ALL OTHER MATERIAL  
FURNISHED BY CONSUMER.