

UNDERGROUND SPECIFICATIONS


HART EMC
P.O. BOX 250
HARTWELL, GA. 30643

1-800-241-4109
376-4714


REVISION DATE: 1-26-96

NO WATER LINE WILL BE INSTALLED IN
SAME TRENCH WITH POWER LINE AFTER 2/1/96.

STANDARD UNDERGROUND METER BASE

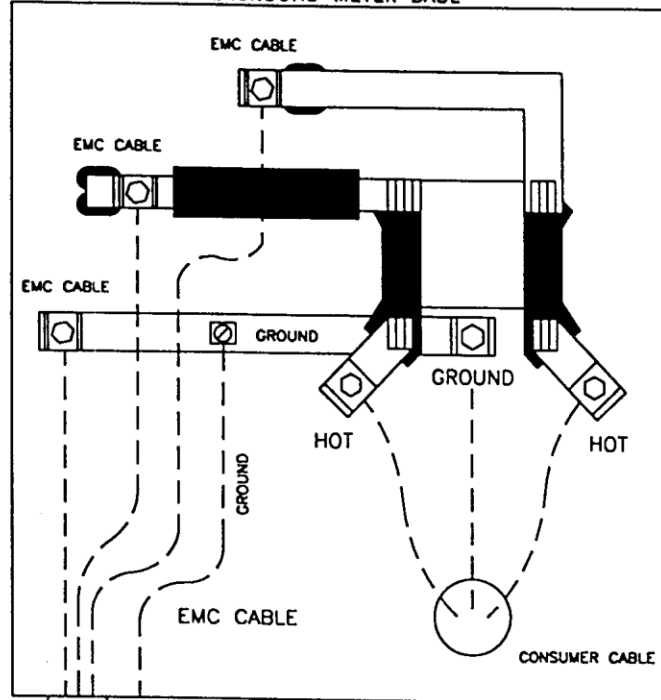


SIDE VIEW

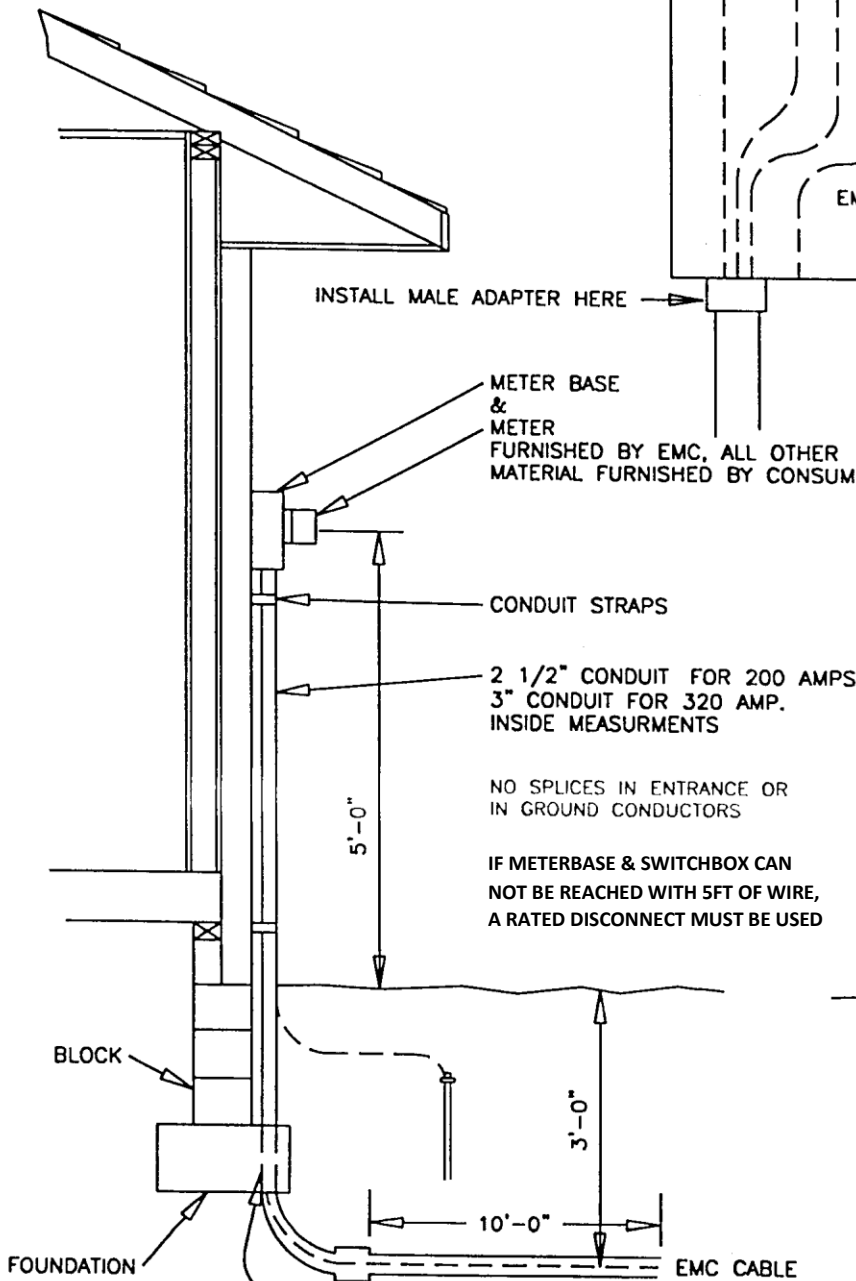

CONSUMER CAN USE MIDDLE
KNOCK OUT, SIDE OR BACK

FRONT VIEW

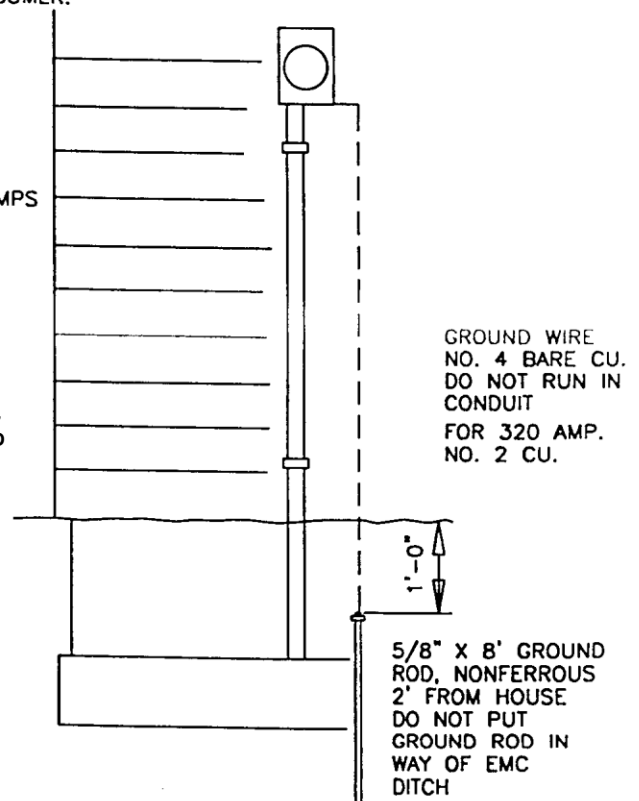

LEAVE 2 - 10' SECTIONS OF PIPE AND SWEEPING "L" LAYING AT
METER BASE. E.M.C. WILL INSTALL WHEN TRENCH IS DUG.
CONSUMER RESPONSIBLE FOR FURNISHING SWEEPING "L" OUT FROM FOUNDATION
WITH 10' SECTION OF CONDUIT. FOUNDATION MUST BE CHISELED OUT TO MAKE JOB
EASIER, FOUNDATION CAN BE FORMED OUT BEFORE CONCRETE IS POURED.
DO NOT CEMENT AROUND CONDUIT.